

# RXA >

RXA wall-mounted cabinet represents the conception of „flat pack“, which means a demountable cabinet that is supplied disassembled.



**FLAT-PACK'S CONCEPTION**

Reduces cost of transportation and storage. Together with a unique construction, it contributes to the attractive price while keeping all functional characteristics.



**FLEXIBLE DOOR OPENING**

The hinge system enables a comfortable access.



**DOOR LOCK**

Locks safely the cabinet and protects the installed devices.




**ADJUSTABLE VERTICAL RAILS**

One pair of vertical 19" rails is step-adjustable in the front cabinet part. This simplifies mounting of the device and organisation of connecting cables.

**DOOR**

These cabinets are supplied only with a glass door with a lock.

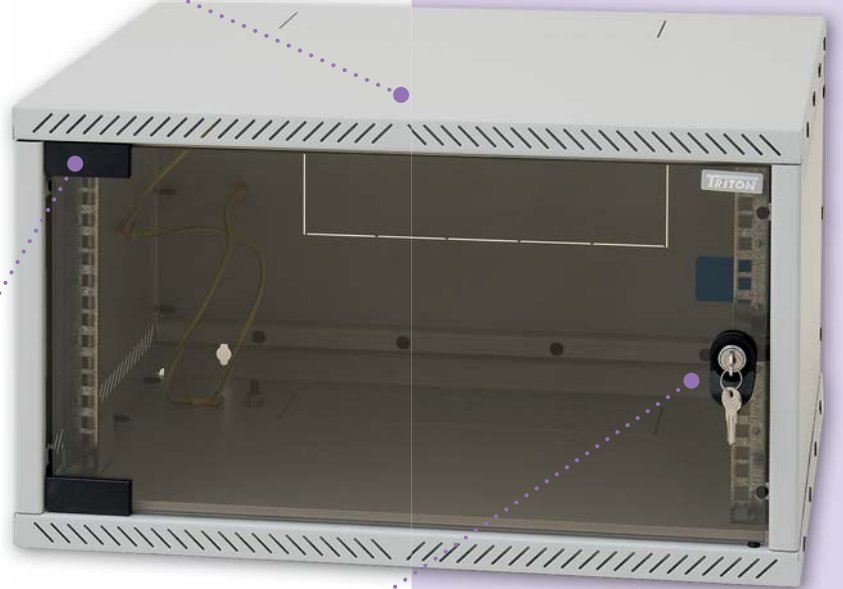

**BREAKOUT-TYPE BLANKING PANELS**

Cable openings covered with breakout-type blanking panels are ready in the top, bottom and rear part of the cabinet.


## RXA (DELTA X AS4)

TYPE	A	B	C	D	E	R1	R2	Weight gross (kg)	Weight net (kg)	Maximal recommended load (kg)
	(mm)									
RXA-04-AS4-CAX-A1	230	180	505	550	400	180	435	11,2	11,0	25
RXA-06-AS4-CAX-A1	320	270	505	550	400	270	435	13,3	13,0	
RXA-09-AS4-CAX-A1	463	412	505	550	400	412	435	15,4	15,1	
RXA-12-AS4-CAX-A1	580	530	505	550	400	530	435	18,7	18,4	



### ASSEMBLY

Thanks to the unique construction, the assembly procedure of RXA takes only few minutes and it does not almost require any tools (Thorx T25). Plastic pins are used to join all the individual parts.

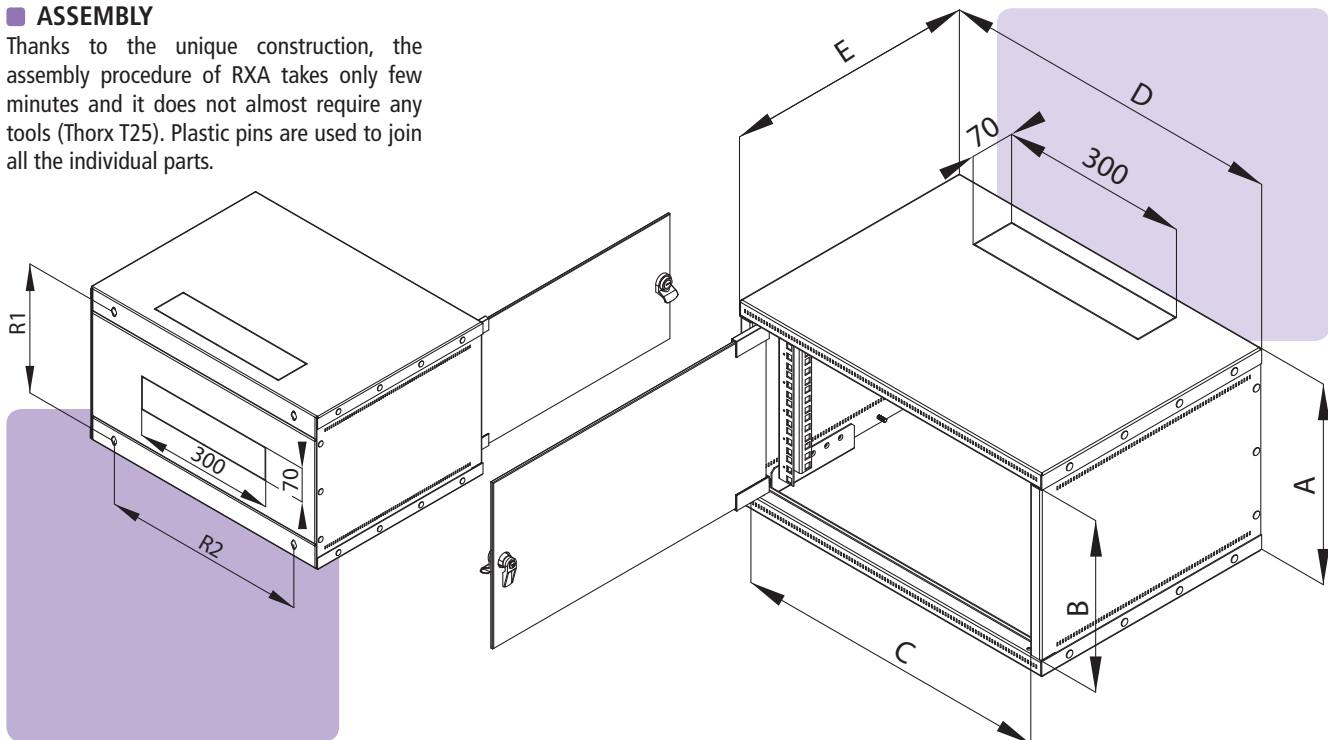



## RXA WALL-MOUNTED CABINET

### ■ DESCRIPTION, PURPOSE OF USE

- Demountable 19" wall mounted cabinet with IP30 protection, supplied disassembled
- Cabinet is to be hanged right on the wall.
- Cabinet includes two adjustable vertical rails.
- Cabinet construction:
  - Cabinet is made from parts joined by plastic pins
  - Glass door: safety hardened glass, thickness 4 mm
- Max. permissible load of the door is 10 kg.
- Min. thickness of the surface finish is 65 µm.
- Cabinets are intended for installation of data and telecommunication devices and their distribution systems.
- All parts are connected with earthing cables that have to be properly fixed and inserted into connectors during all the time when using the cabinet.
- There is one M8 screw placed on the bottom part of the cabinet as an earthing main point.
- Cable openings covered with breakout-type blanking panels are placed in the top and the bottom part of the cabinet rear side, others are in the top and the bottom side of cabinet.

### ■ OPERATION CONDITIONS

- Operation environment:
  - Office
  - The cabinet is not intended for outdoor installations and for installations in environment that can influence negatively the functionality of the cabinet and the mounted devices (e.g. environment with danger of explosion or humid and wet surroundings)
- Must be protected against:
  - Mechanical damage
  - Improper manipulation
  - A different usage than the cabinet is intended for
- Improper manipulation is especially:
  - Overloading (maximum recommended load exceeding)
  - Device installation that can influence negatively operation and function of the cabinet or the installed equipment
  - Change of the construction or design of the cabinet

### ■ INSTALLATION OF THE CABINET

- It is necessary to assemble all single cabinet parts and to join them with delivered plastic pins. See the enclosed manual for the detailed assembly procedure.
- This type of cabinet is to be hanged right on the wall using screws, wall plugs and washers. Spacing of mounting holes is indicated as „R“ in the cabinet scheme.
- To secure the maximum recommended load, it is necessary to fix the cabinet on the wall with an appropriate carrying capacity (brick, concrete or similar) and to distribute the installed loading equally.
- To avoid dust penetration in case that cables lead through some of the cable openings, you can seal it with the use of a blanking panel with a brush.

### ■ ENVIRONMENT PROTECTION

- All parts are made of recyclable materials and after its discard, it is necessary to dispose the cabinet according to valid regulations.

### ■ CERTIFICATE AND CONFORMITY

- This product is certified by ITI TÜV, certification number 01.064.846/09/07/02/0, date 10/12/2009 and is fully in accordance with ČSN EN 62208, ČSN 73 1401+Z1 a Z2, ČSN 73 0035.